


WP-CP-001-1

EXISTING CONTROL PANEL LOCATED
IN EXISTING CONTROL ROOM

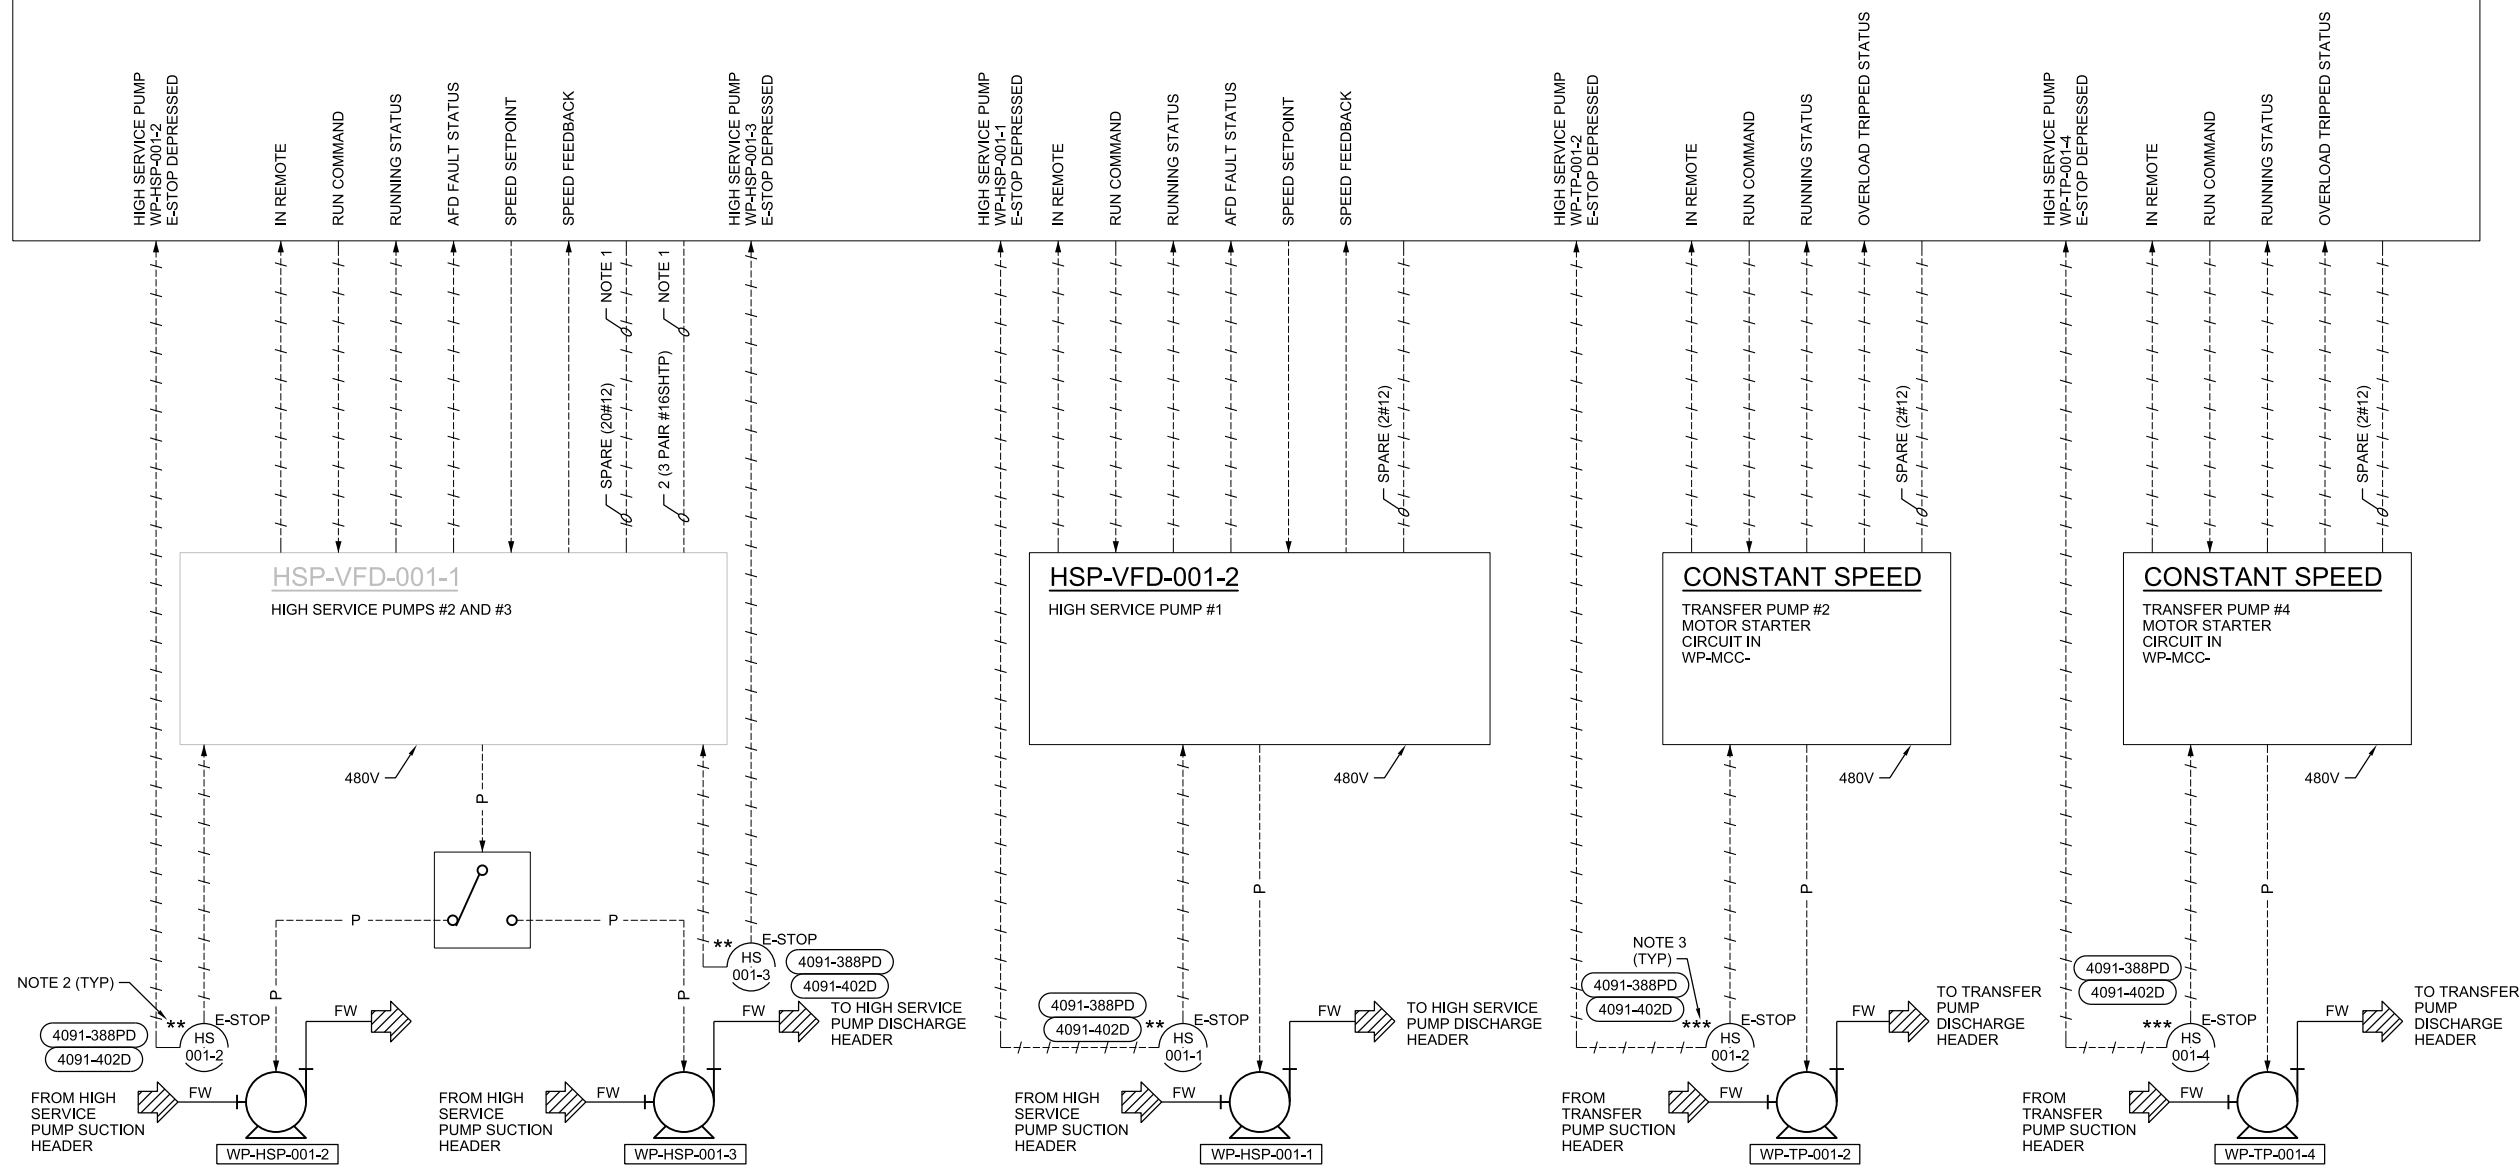

- NOTES:**
1. COIL AND TAPE OFF 20 FEET OF SPARE CABLE IN BOTH THE EXISTING MCC AND IN WP-CP-001-1.
 2. **COMPLETE INSTRUMENT TAG NUMBER INCLUDES "WPHSP" PREFIX.
 3. ***COMPLETE INSTRUMENT TAG NUMBER INCLUDES "WPTP" PREFIX.

ch2m
WTP INSTRUMENTATION AND CONTROL
INTERCONNECTION DIAGRAM

CH2M Hill Engineers, Inc.
TBE FIRM NO. 3699
Wastewater Treatment Plant
Water Treatment Plant and Prison Lift Station
Improvements
City of Pampa, Texas

DATE: MARCH 2016
PROJ: 659681
DWG: 300-I-1
SHEET: 89 of 125

NTS
VERIFY SCALE
BAR IS ONE INCH ON ORIGINAL DRAWING.

NO. DATE DSGN DR T HOVEN T RIDGIK G MORAN T HOVEN
REVISION CHECK APVD BY APVD
T HOVEN
©CH2M HILL 2014. ALL RIGHTS RESERVED.